



全体平面図

S=1 : 3000

位置図 S=FREE

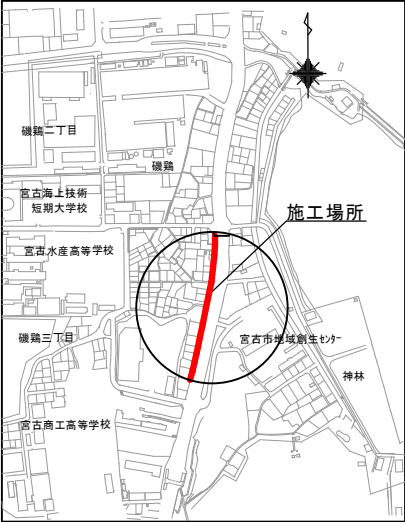

施工場所
一般国道45号神林地区配水管布設工事

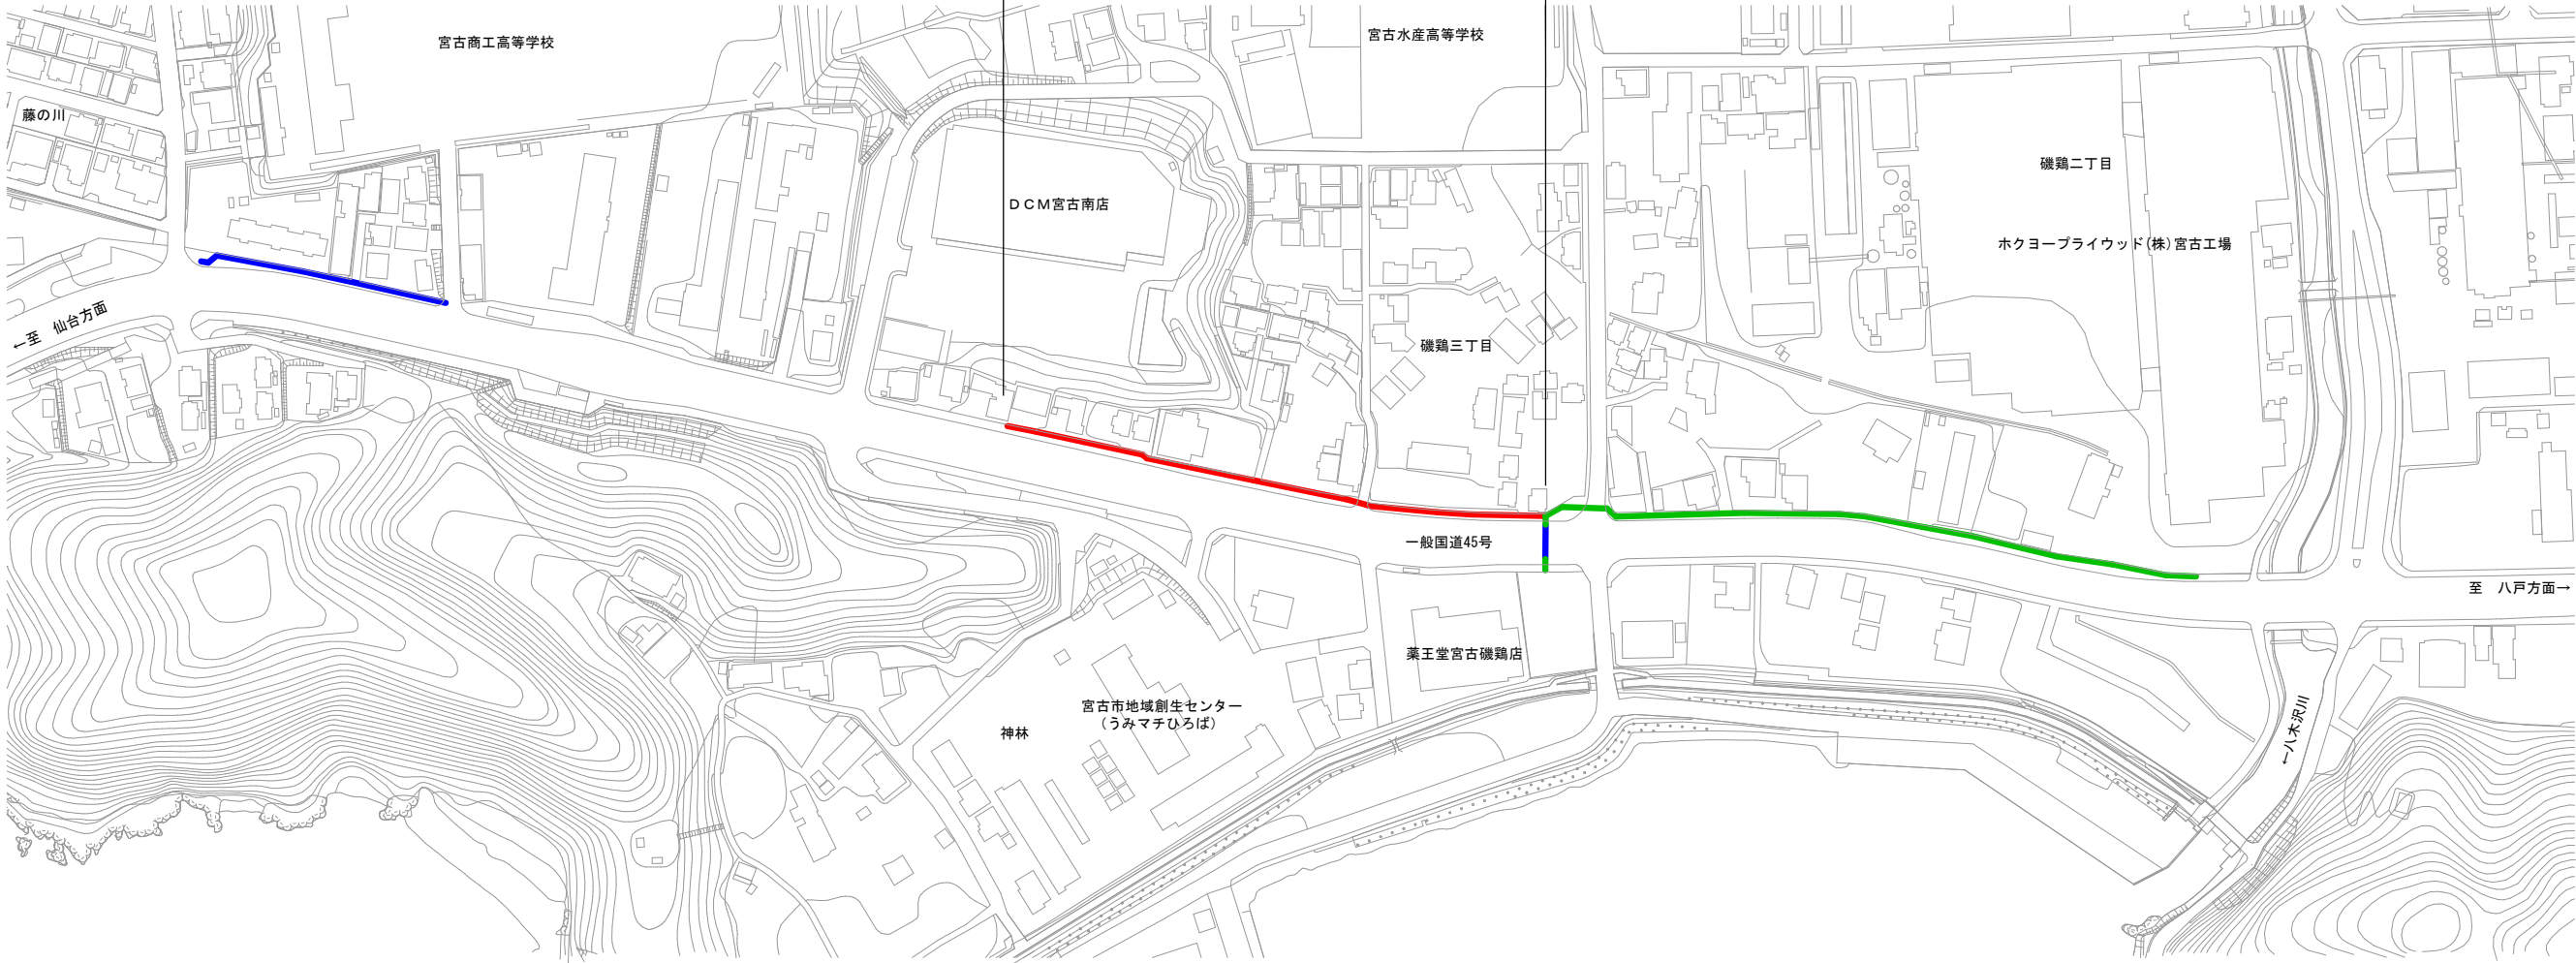


- 【凡例】
- R8本工事
 - 施工済み
 - R9以降工事(予定)

R8実施


宮古市上下水道部施設課	工 事 名	一般国道45号神林地区配水管布設工事		
	図 種	位置図、全体平面図		
	縮 尺	図示		
	年 月	令和 8年10月	業 内	1 / 10

平面図（1） S=1:500
(神林地区)



施工延長 L= 227.8 m

配水管布設工DIP-GXφ75 L= 153.4m

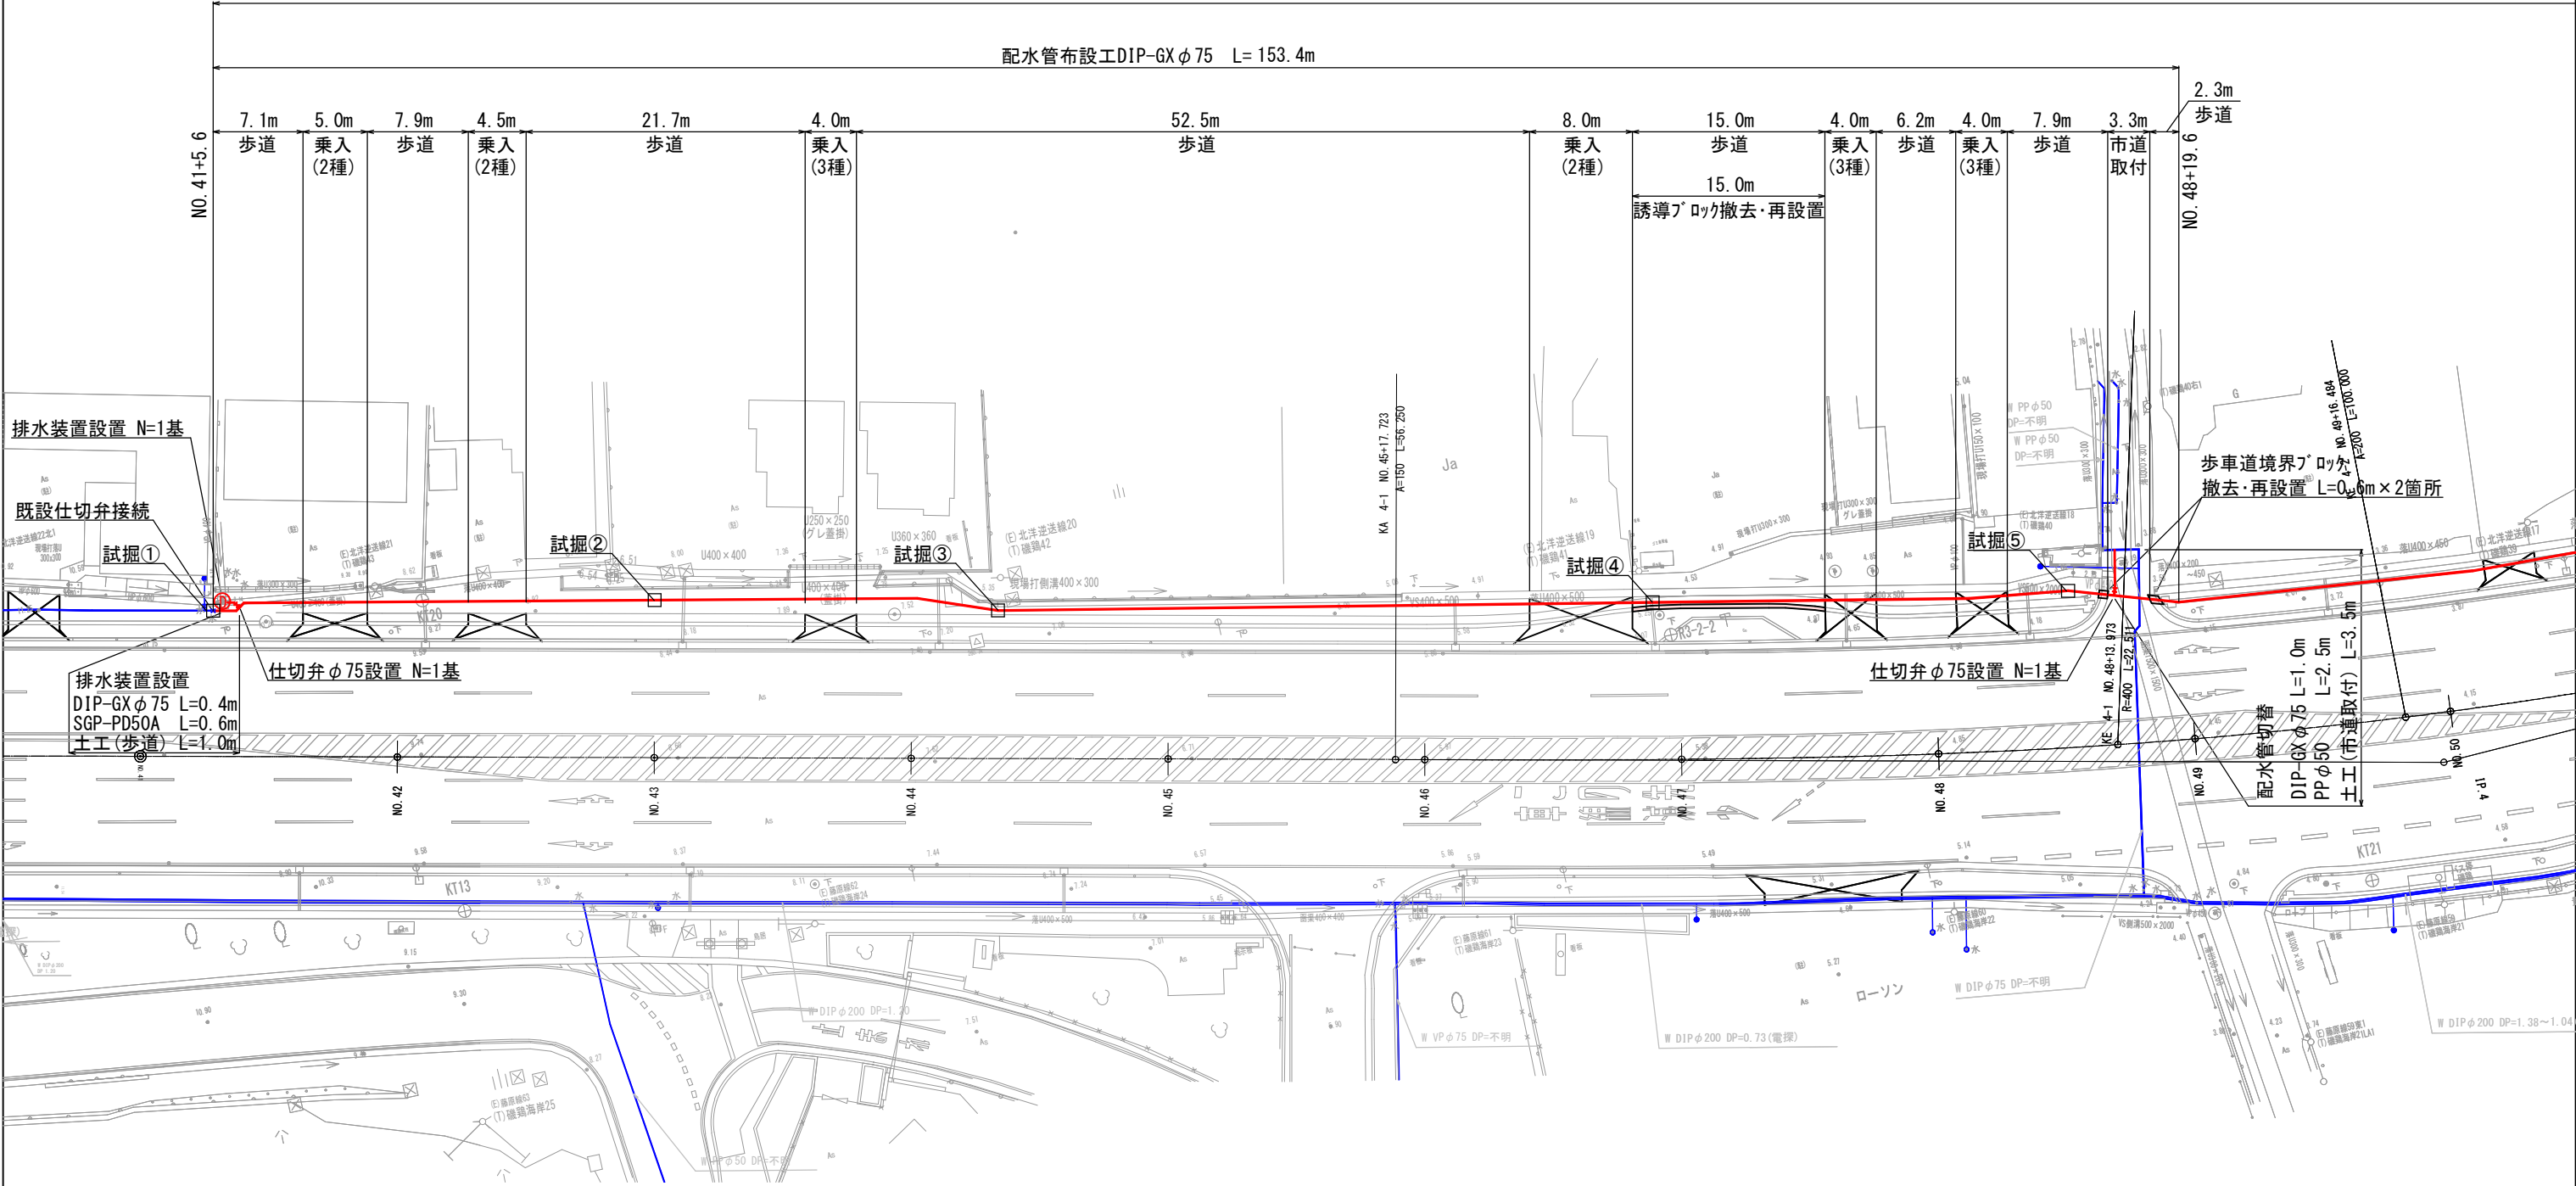


- 【凡例】
- : 既設配水管
 - : 新設配水管（本工事）
 - : 新設配水管（別工事）

R8実施

宮古市上下水道部施設課	工 事 名	一般国道45号神林地区 配水管布設工事	
	図 種	平面図（1）	
	縮 尺	1：500	
	年 月	令和 8年10月	業 内 2 / 10

S=1 : 500

(神林地区)



施工延長 L= 227.8m







【凡例】

 : 既設配水管
 : 新設配水管（本工事）
 : 新設配水管（別工事）

R8実施

宮古市上下水道部施設課	工 事 名		一般国道45号神林地区 配水管布設工事	
	図 種		平面図（2）	
	縮 尺		1：500	
	年 月	令和 8年10月	業 内	3 / 10


管 割 図 (参考) S=FREE

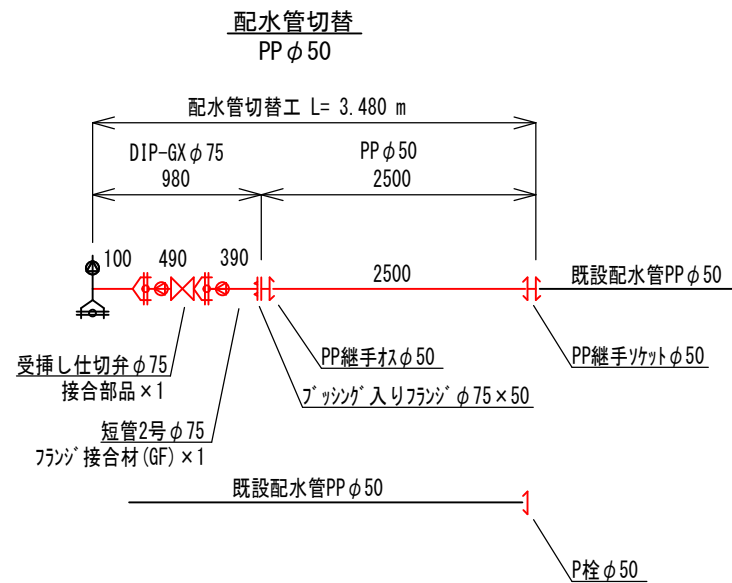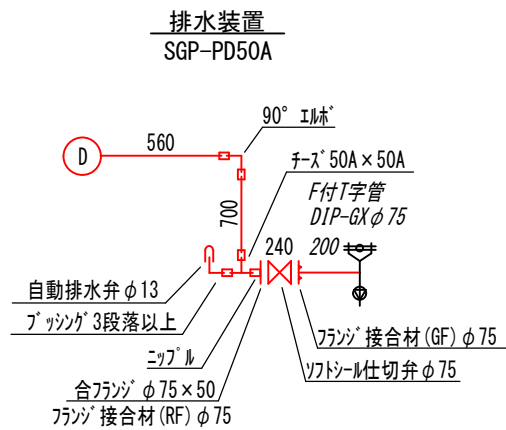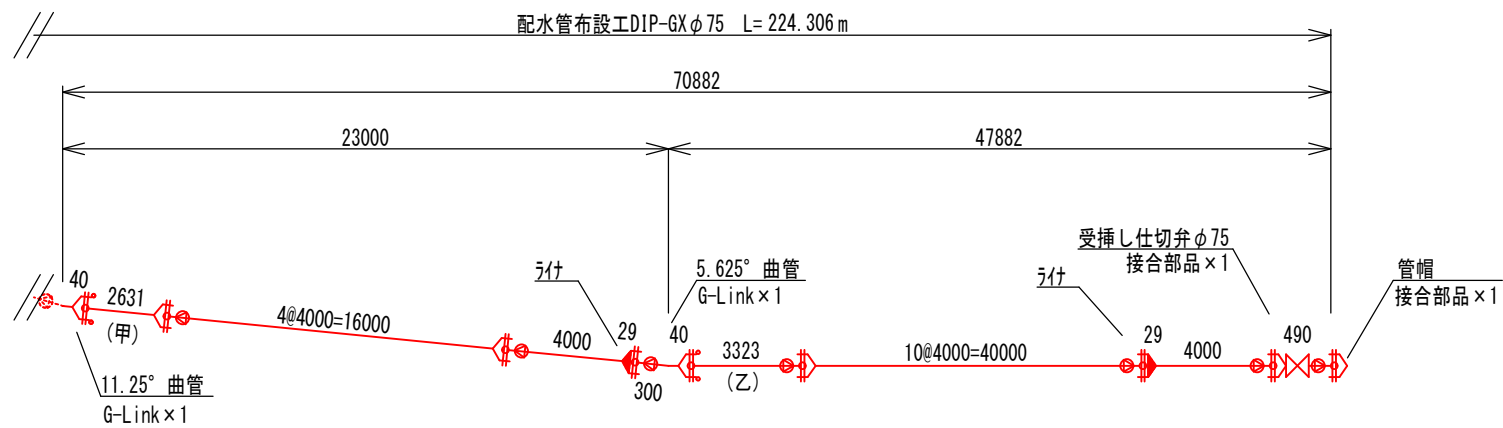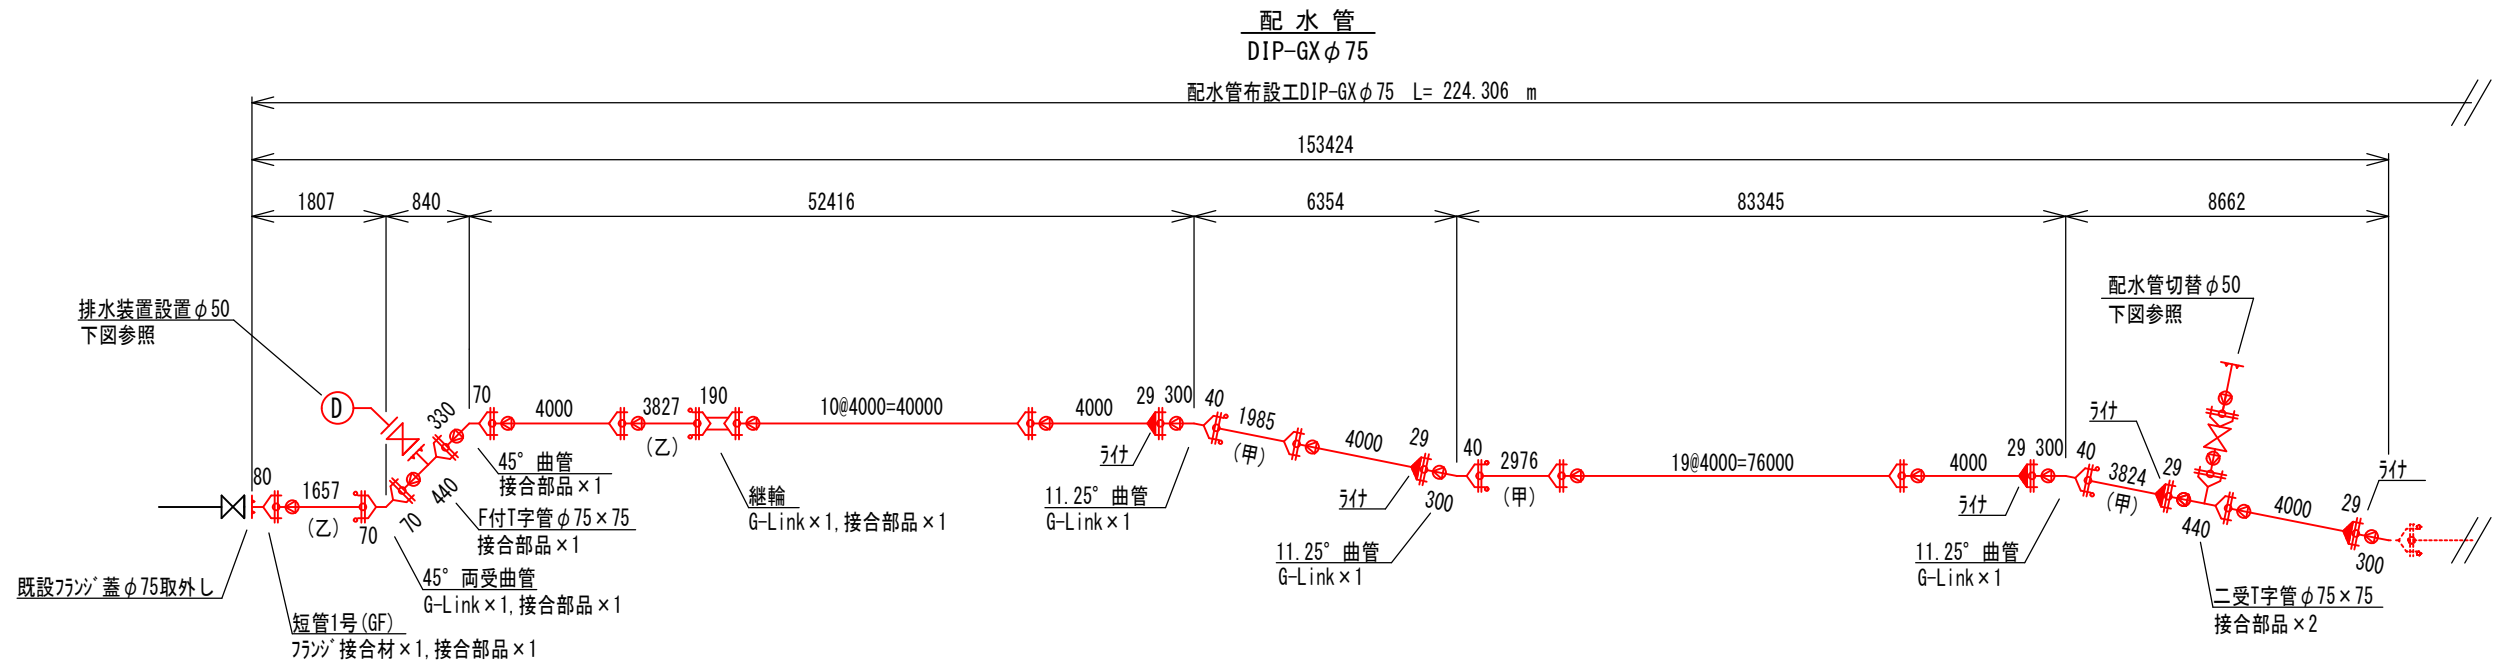

R8実施

宮古市上下水道部施設課	工 事 名	一般国道45号神林地区 配水管布設工事		
	図 種	管割図 (参考)		
	縮 尺	FREE		
	年 月	令和 8年10月	業 内	4 / 10


横断図（１） S=1:200
(神林地区)

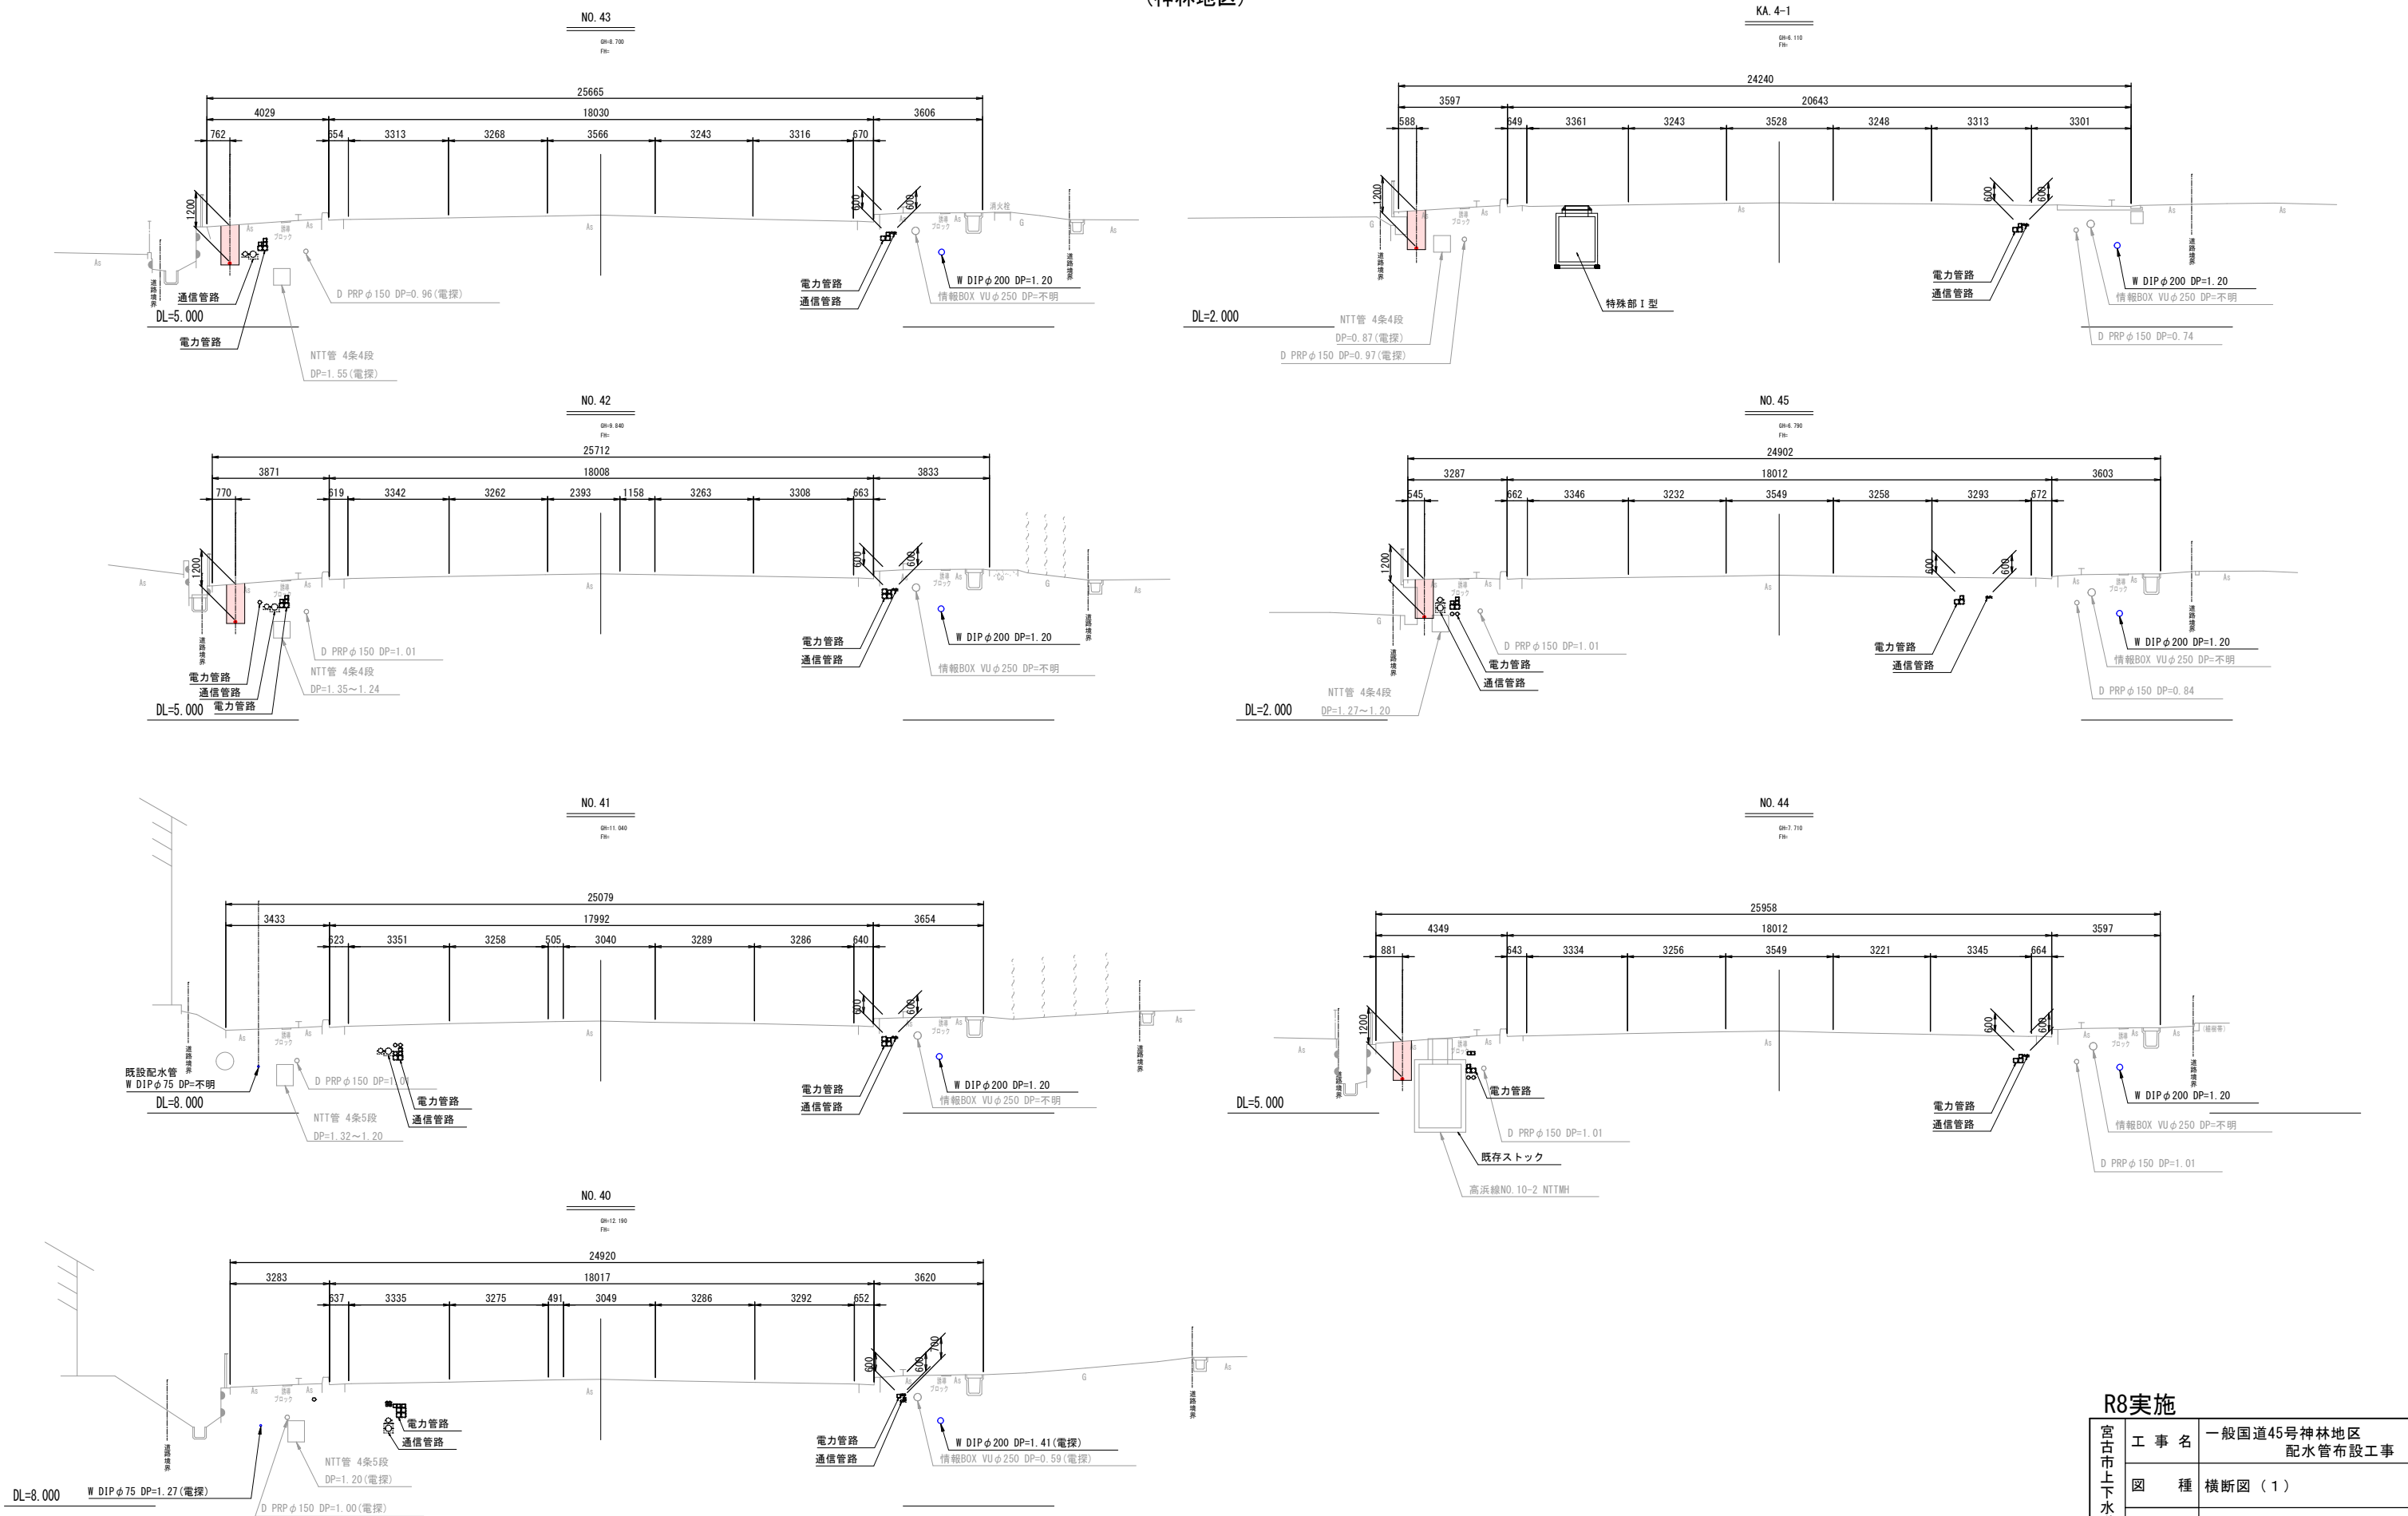

R8実施

宮古市上下水道部施設課	工 事 名		一般国道45号神林地区 配水管布設工事	
	図 種		横断図（１）	
	縮 尺		1：200	
	年 月	令和 8年10月	葉 内	5 / 10

横断図（ 2 ） S=1:200
(神林地区)

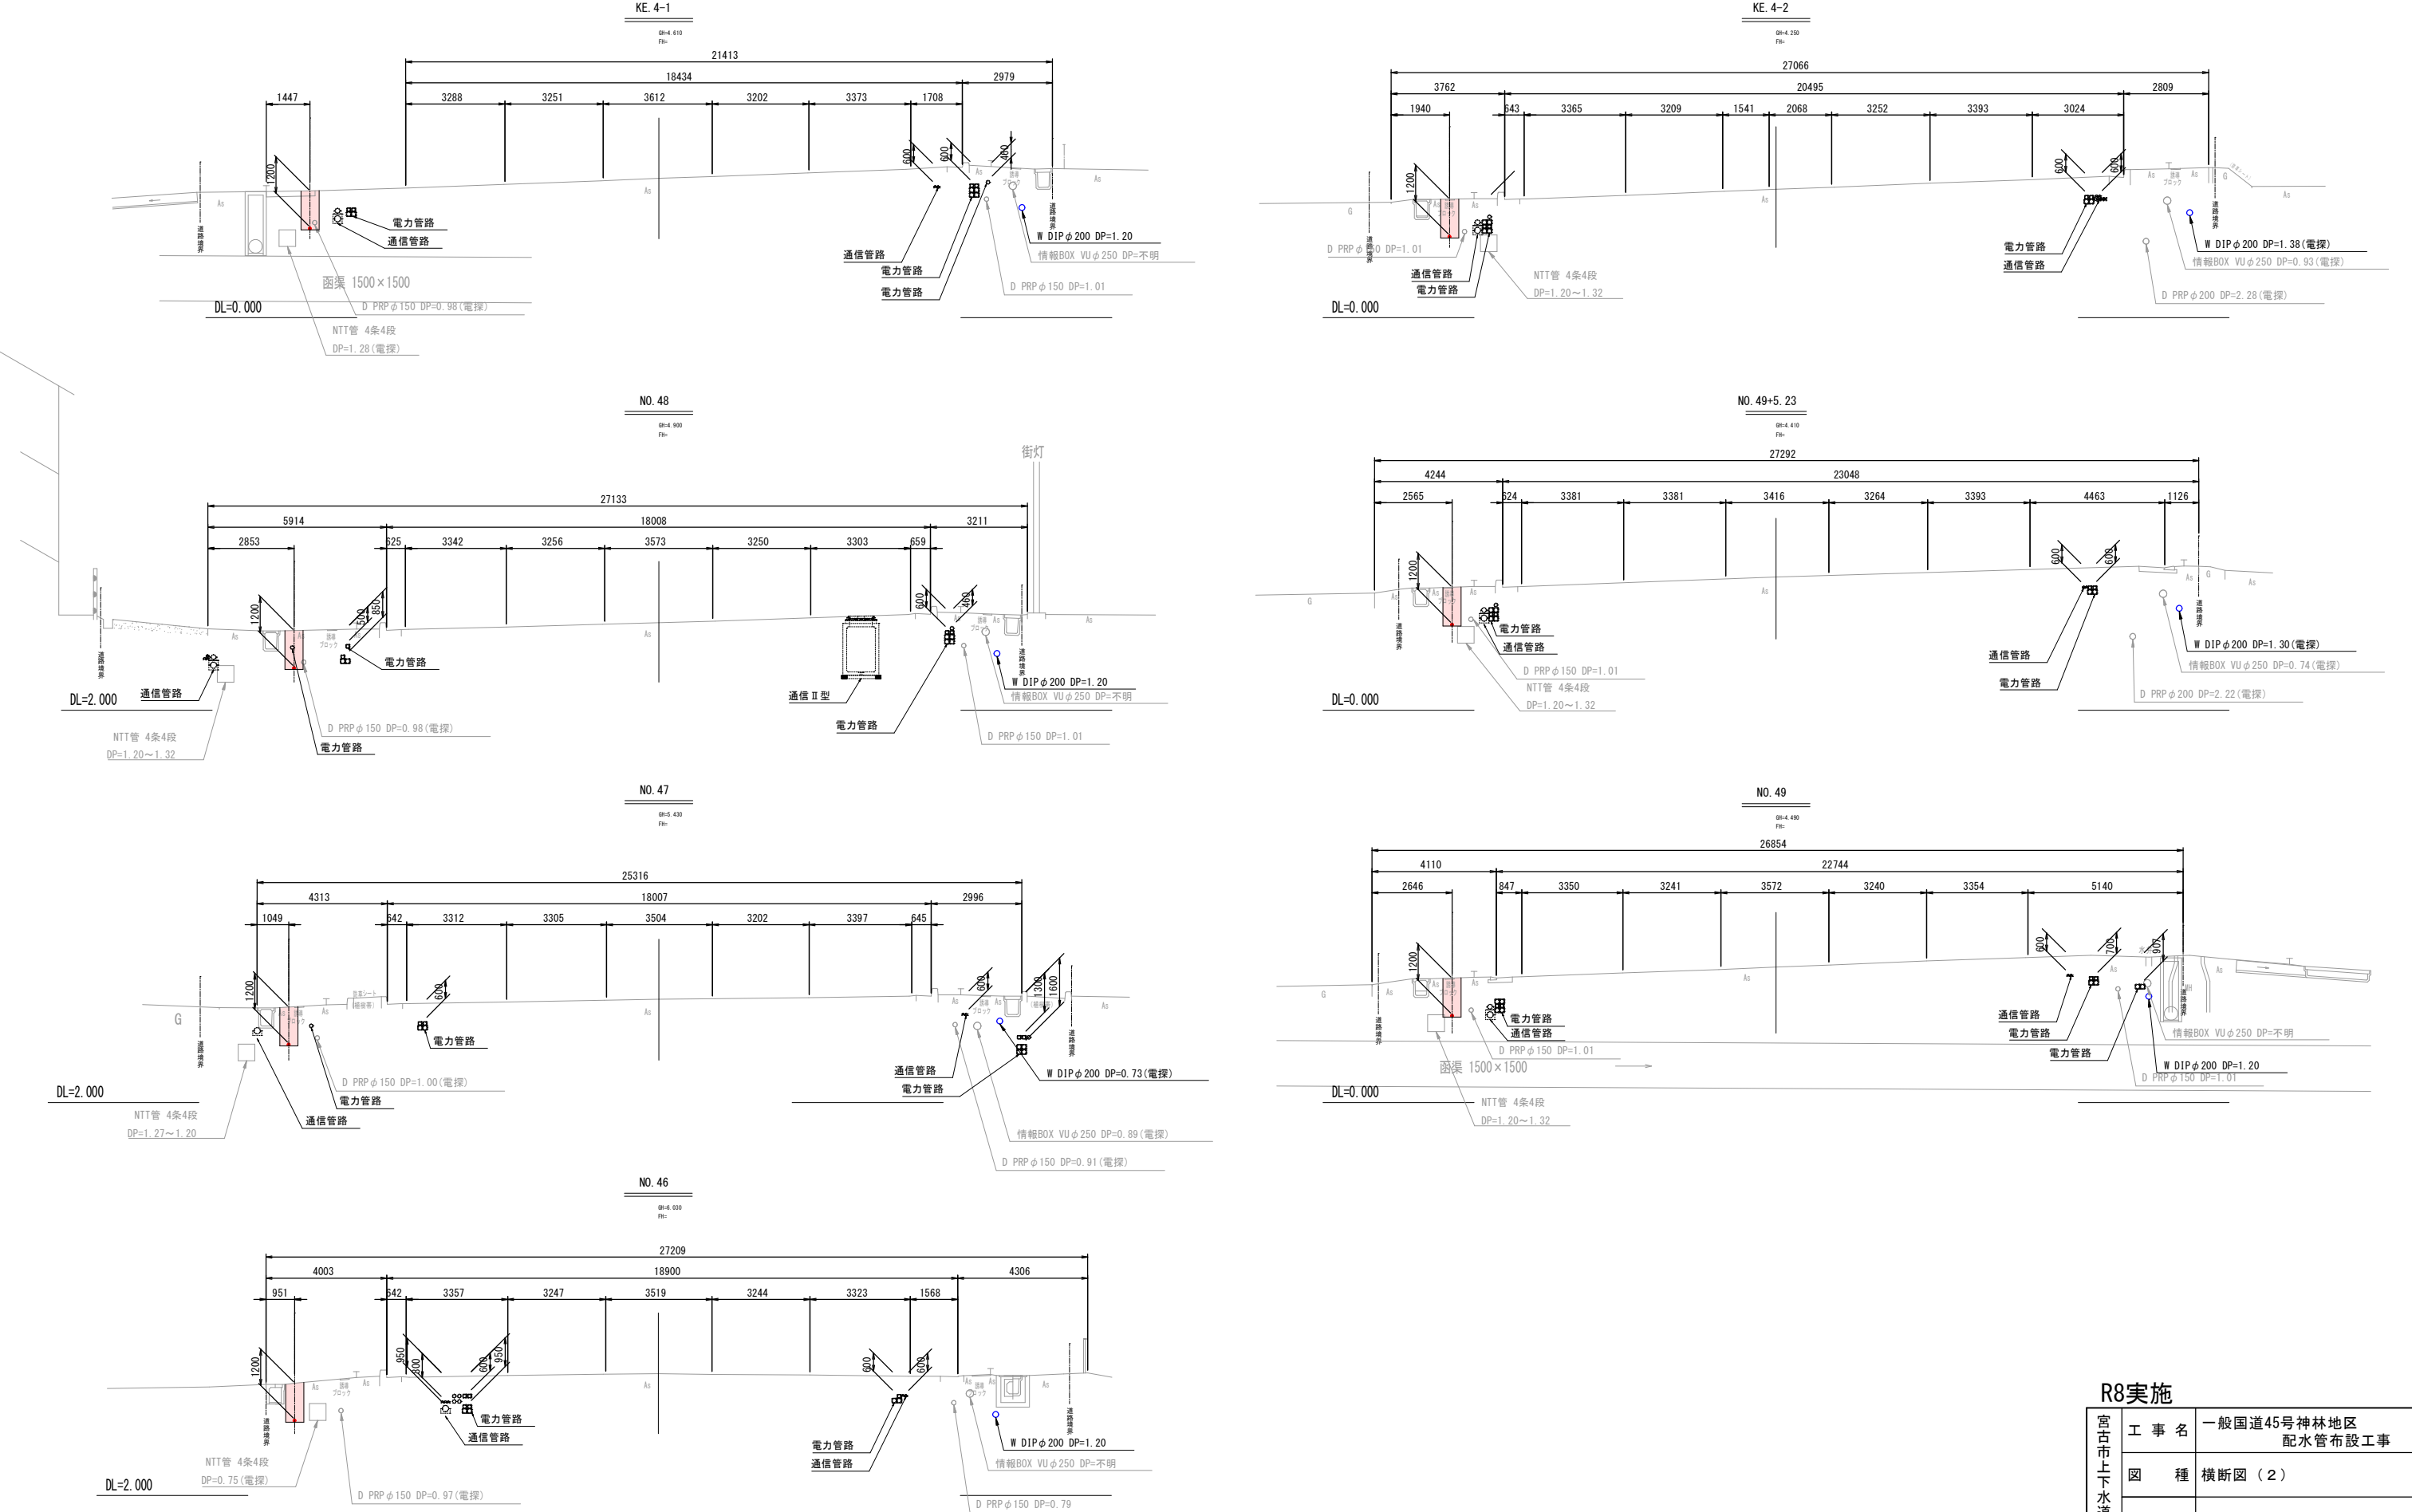


R8実施

宮古市上下水道部施設課	工 事 名	一般国道45号神林地区 配水管布設工事		
	図 種	横断図（ 2 ）		
	縮 尺	1 : 200		
	年 月	令和 8年10月	葉 内	6 / 10

横断図（3） S=1:200
(神林地区)


NO. 53

GH=3.570
FR=

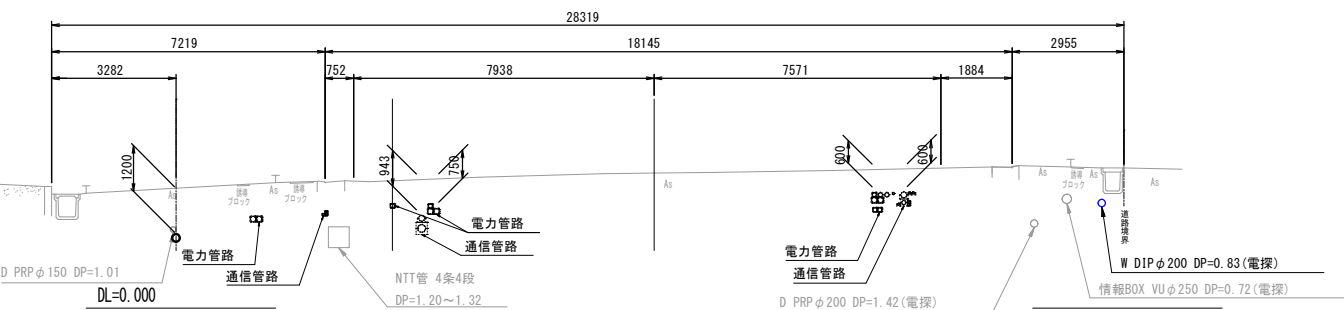


NO. 52

GH=3.760
FR=

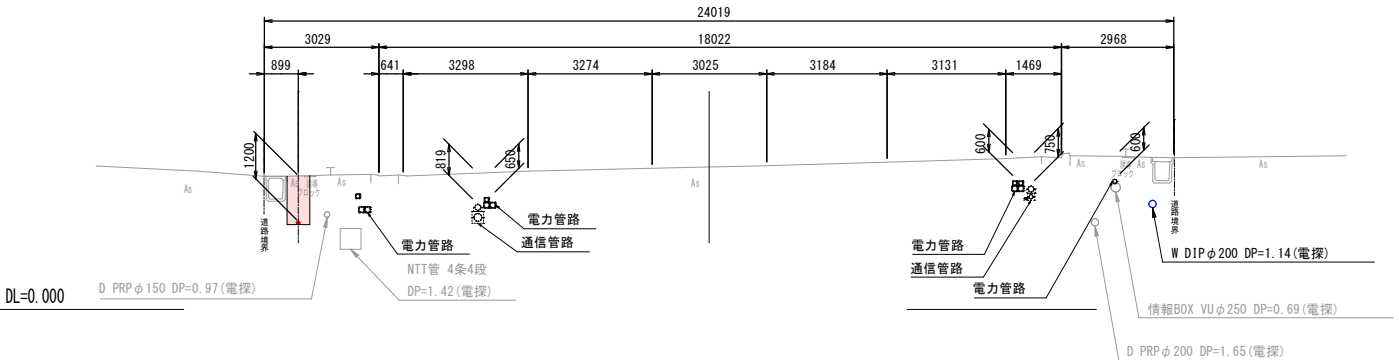


NO. 51

GH=3.990
FR=

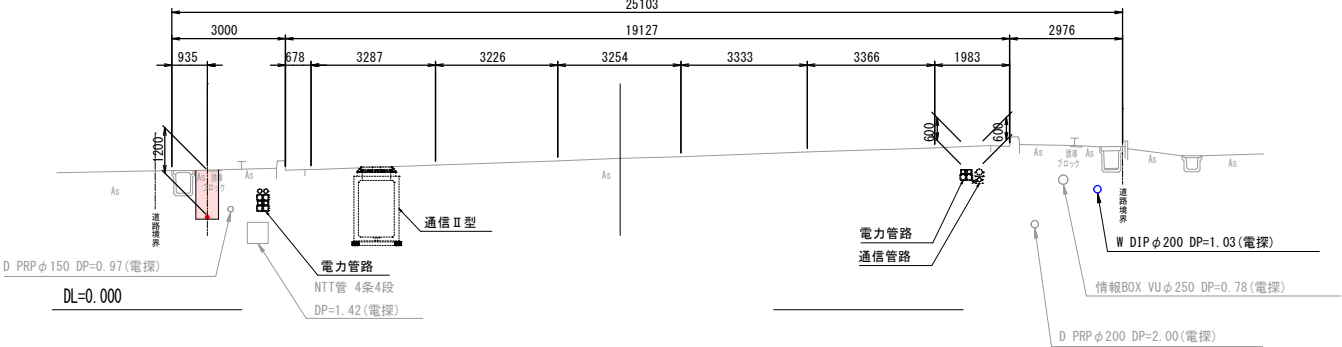


NO. 50

GH=4.190
FR=

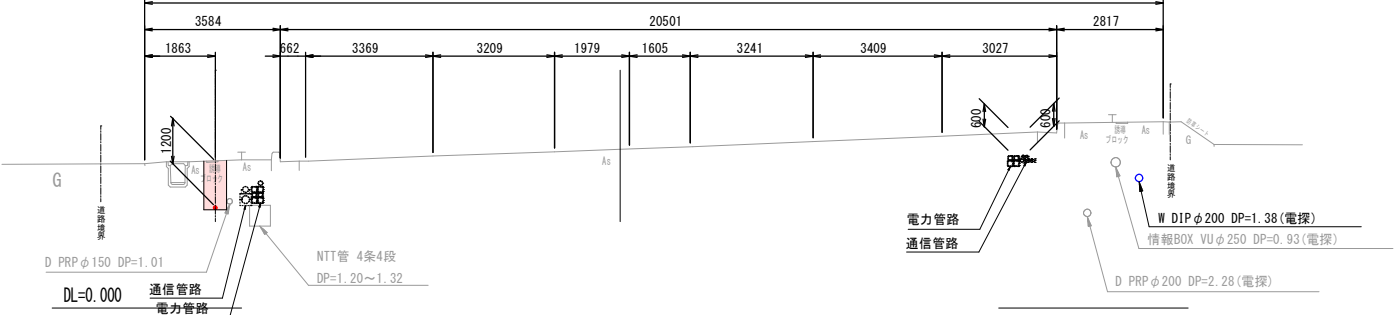


NO. 55

GH=3.180
FR=

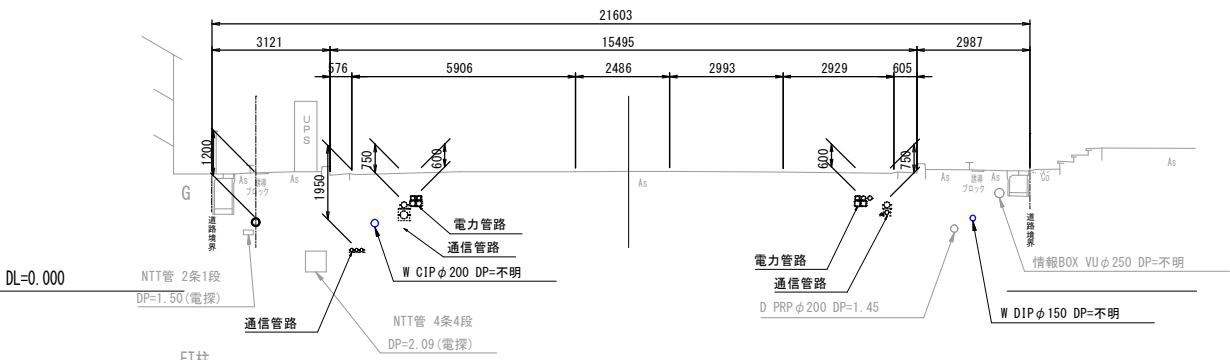


KA. 4-2

GH=3.180
FR=

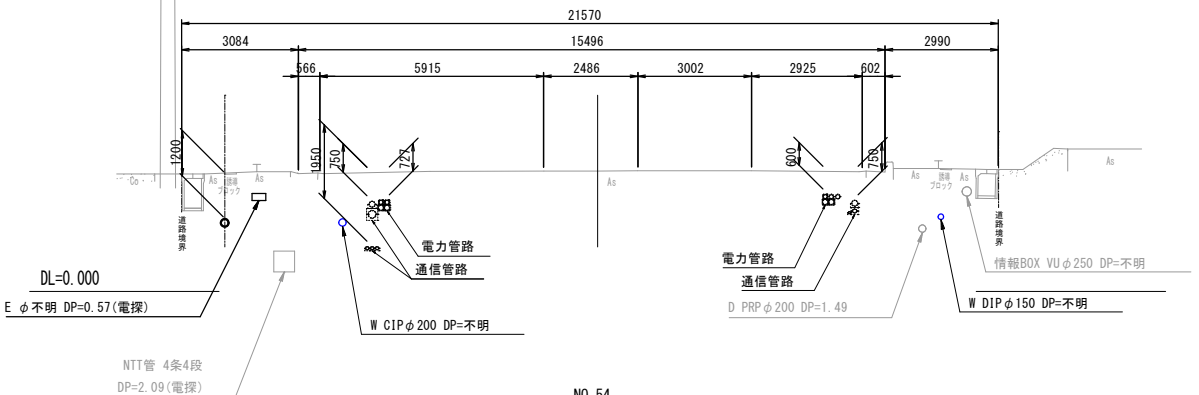

NO. 54

GH=3.350
FR=

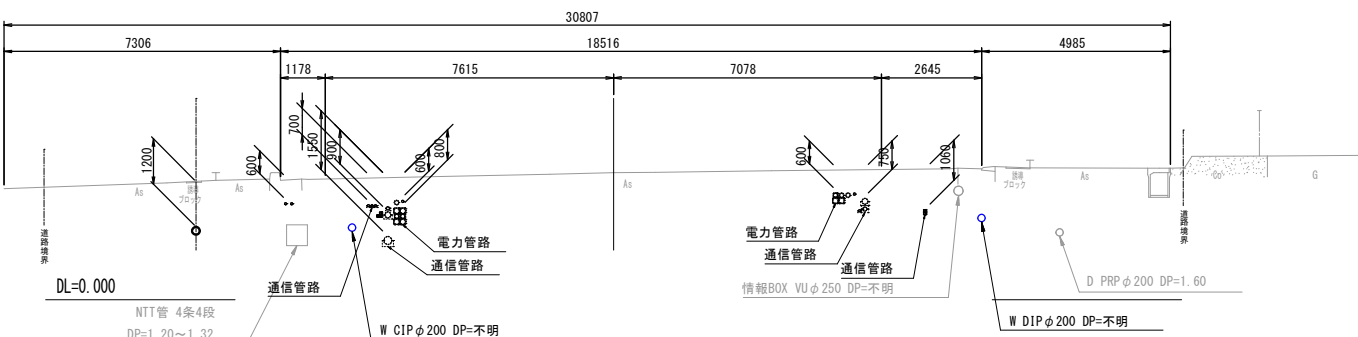

R8実施

宮古市上下水道部施設課	工 事 名	一般国道45号神林地区 配水管布設工事	
	図 種	横断図（3）	
	縮 尺	1 : 200	
	年 月	令和 8年10月	業 内 7 / 10

$S=1:20$

歩道部

600

掘削 埋戻

再生密粒度As (13)
(As仮復旧)

As

RC-40

埋設表示シート
(W=15cmタプル)

良質発生土

1200

40

1250

30

110

1150

1290

DIP-GX ϕ 75 (SGP50A)

ポリエチレンスリーブ被覆

乗入部 (第3種)

600

掘削 埋戻

再生密粒度As (20)
(As仮復旧)

50

As As (仮)

RC-40

250

埋設表示シート
(W=15cmダブル)

良質発生土

50

990

1290

1200

1240

DIP-GX ϕ 75

ボリエレンスリーブ被覆

乗入部(第2種)

600

掘削 埋戻

再生密粒度As(20)
(As仮復旧)

As As(仮)

RC-40

埋設表示シート
(W=15cmダブ)

良質発生土

1200

100

1190

50

300

940

1290

DIP-GX φ75

※ リエフレックスリブ 被覆

市道取付部

掘削
埋戻

600

再生密粒度As(20)
(As仮復旧)

As

As (仮)

RC-40

埋設表示シート
(W=15cm×7' 尺)

良質発生土

50

400

840

1290

150

1140

1200

DIP-GXφ75

※ リフレッシュスリーブ® 被覆

歩道部

600

掘削 埋戻

再生密粒度As(13)
(As仮復旧)

As

RC-40

埋設表示シート
(W=15cmタフル)

良質発生土

SGP50A

1200

40

1220

30

110

1120

1260

歩道部

600

掘削

埋戻

再生密粒度As (13)
(As仮復旧)

As

RC-40

埋戻表示シート
(W=15cm^φブ^ル)

良質発生土

1200

40

1250

110

30

1150

1290

DIP-GX φ 75 (SGP50A)

リズレンスリープ[®] 被覆

市道取付部

掘削 埋戻

再生密粒度As (20)
(As仮復旧)

As (仮)

RC-40

埋設表示シート
(W=15cm²、7'、ル)

良質発生土

保護砂

PP φ 50

1200

1210

150

600

50

400

650

260


1360

Figure 1: Plan view of the test excavation area. The diagram shows a rectangular excavation site with a total width of 1000 mm and a total depth of 1290 mm. The site is divided into two main sections: "掘削" (Excavation) on the left and "埋戻" (Backfill) on the right. The "掘削" section is further divided into "機械掘削" (Mechanical Excavation) and "人力掘削" (Manual Excavation). The "埋戻" section is divided into "RC-40" (Reinforced Concrete) and "再生密粒度As (13)" (Recycled Fine-grained As (13)). A "埋設表示シート (W=15cm グル)" (Burial Indication Sheet (W=15cm Grid)) is shown in the "埋戻" section. Dimensions are indicated by arrows: 40 mm for the top layer, 500 mm for the mechanical excavation depth, 750 mm for the manual excavation depth, 110 mm for the RC-40 layer, and 1150 mm for the manual excavation depth. A note at the bottom states: "※試掘調査の延長は1メートルとする。" (Note: The extension of the test excavation is 1 meter.)


宮古市上下水道部施設課	工 事 名		一般国道45号神林地区 配水管布設工事	
	図 種		土工標準図	
	縮 尺		図 示	
	年月	令和8年10月	葉内	8 / 10

弁筐標準図
S=1 : 20

仕切弁および弁筐
平面図

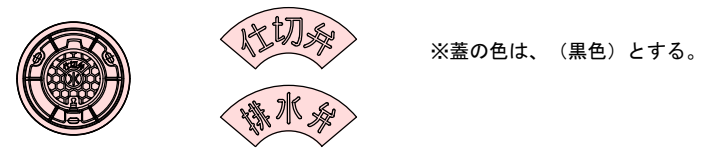



側面図

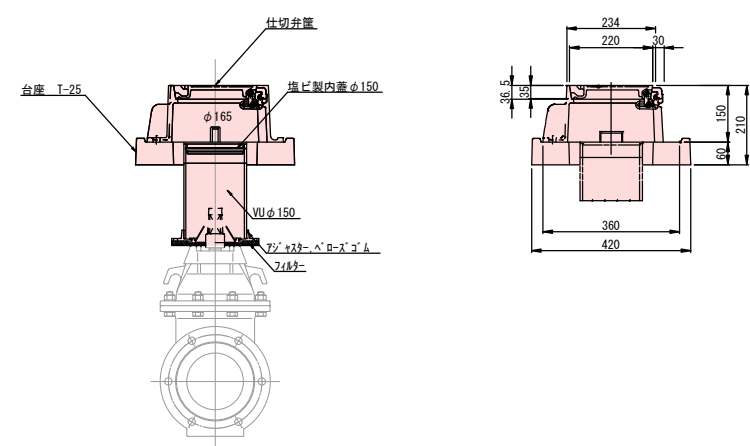

R8実施				
宮古市 上下水道部 施設課	工 事 名	一般国道45号神林地区 配水管布設工事		
	図 種	弁筐標準図		
	縮 尺	S=1 : 20		
	年 月	令和 8年10月	葉 内	9 / 10



給水切替詳細図

平面図 S=1:500

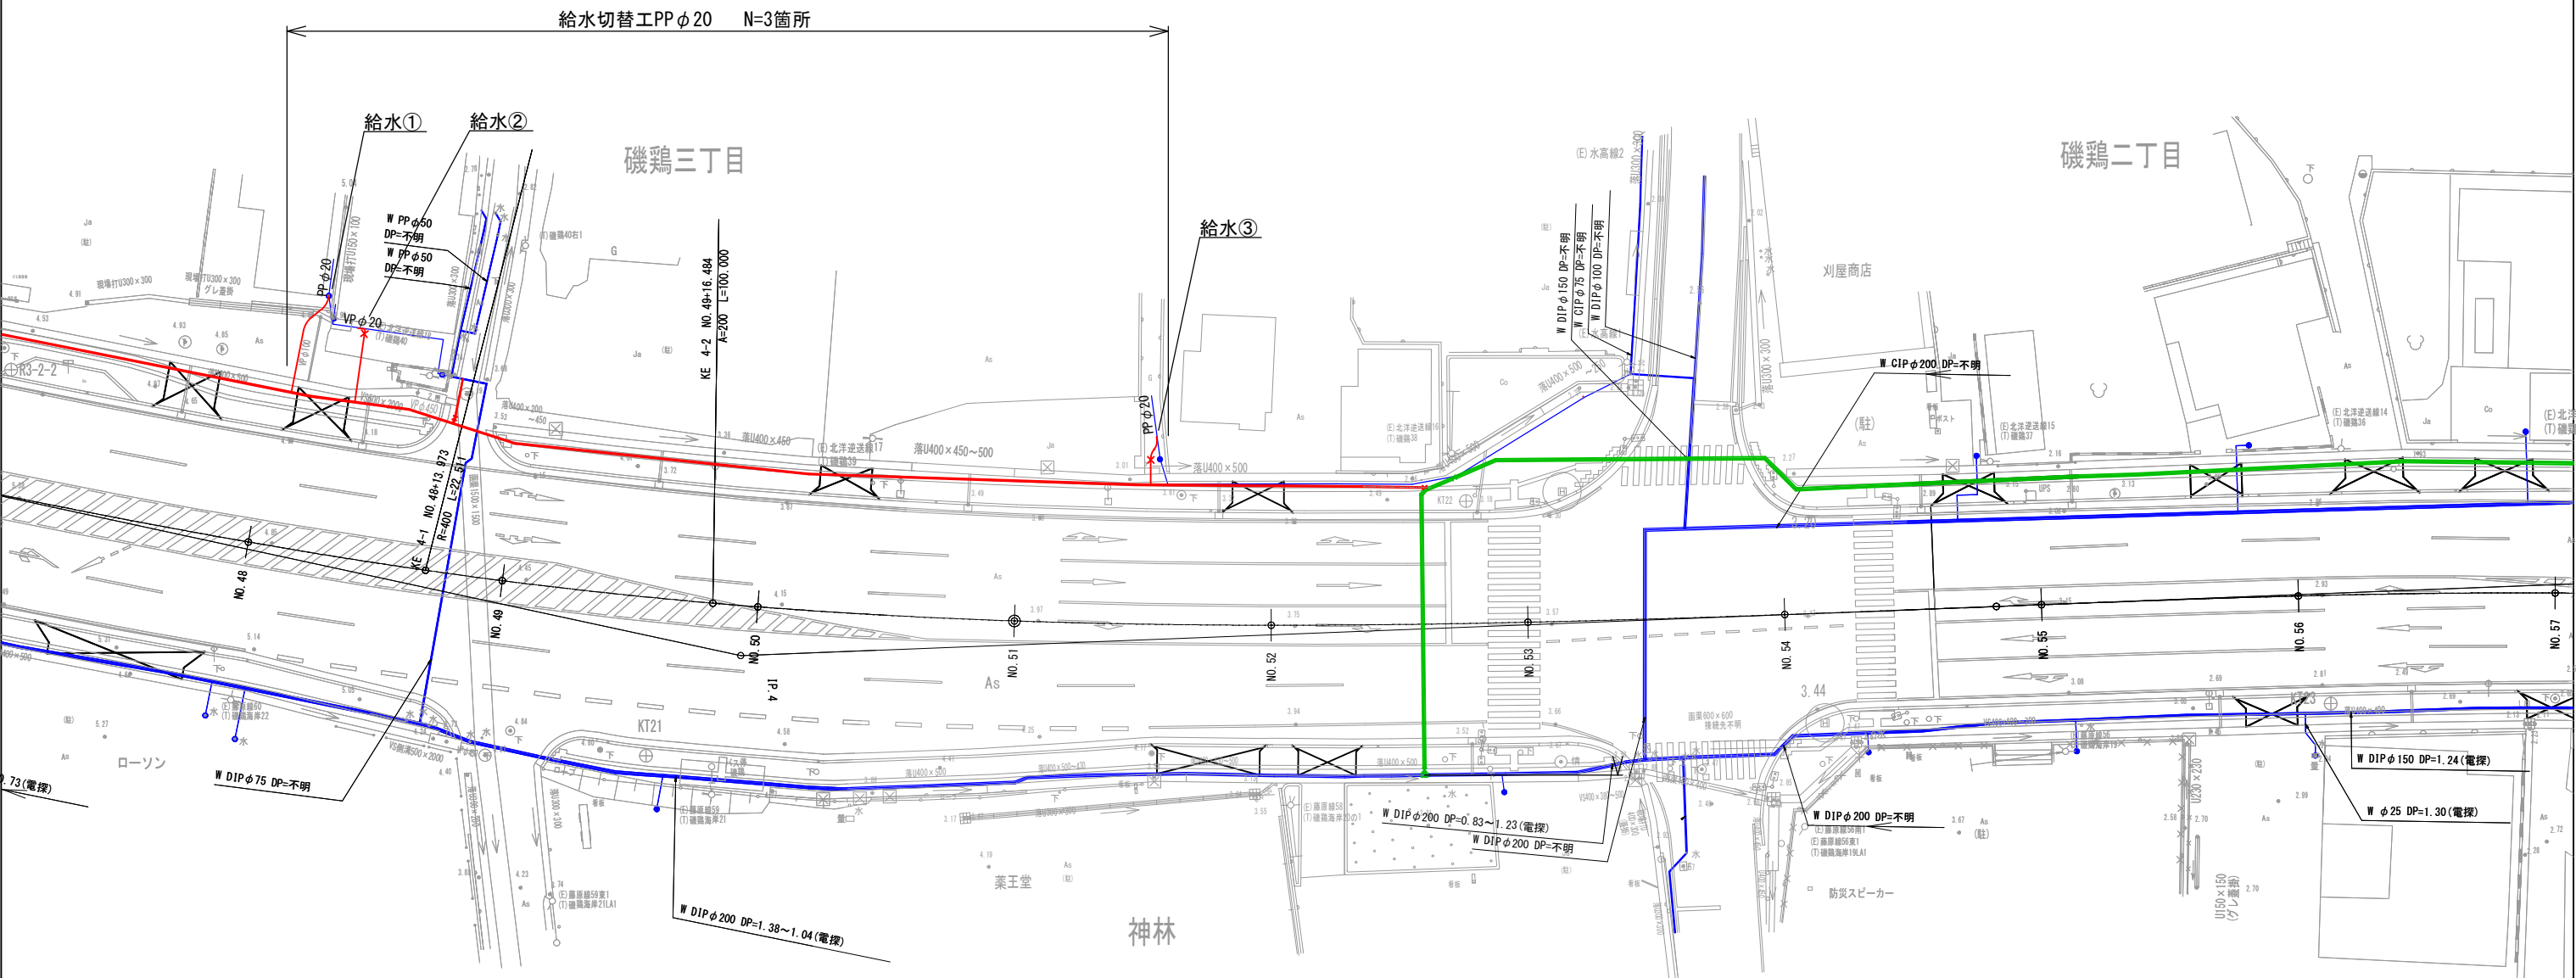

管割図(参考) S=FREE

土工標準図 S=1:20

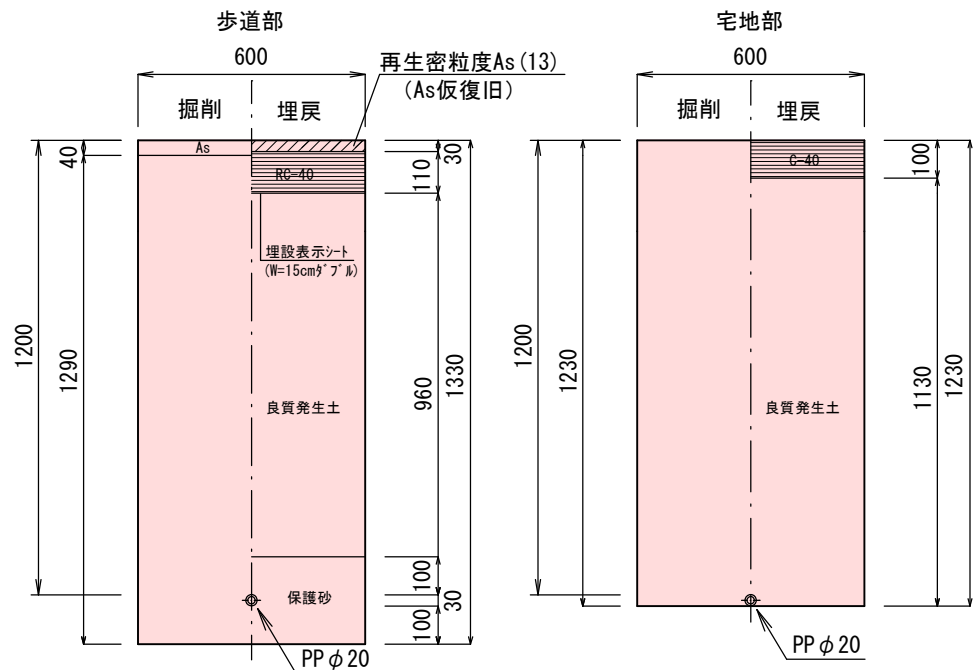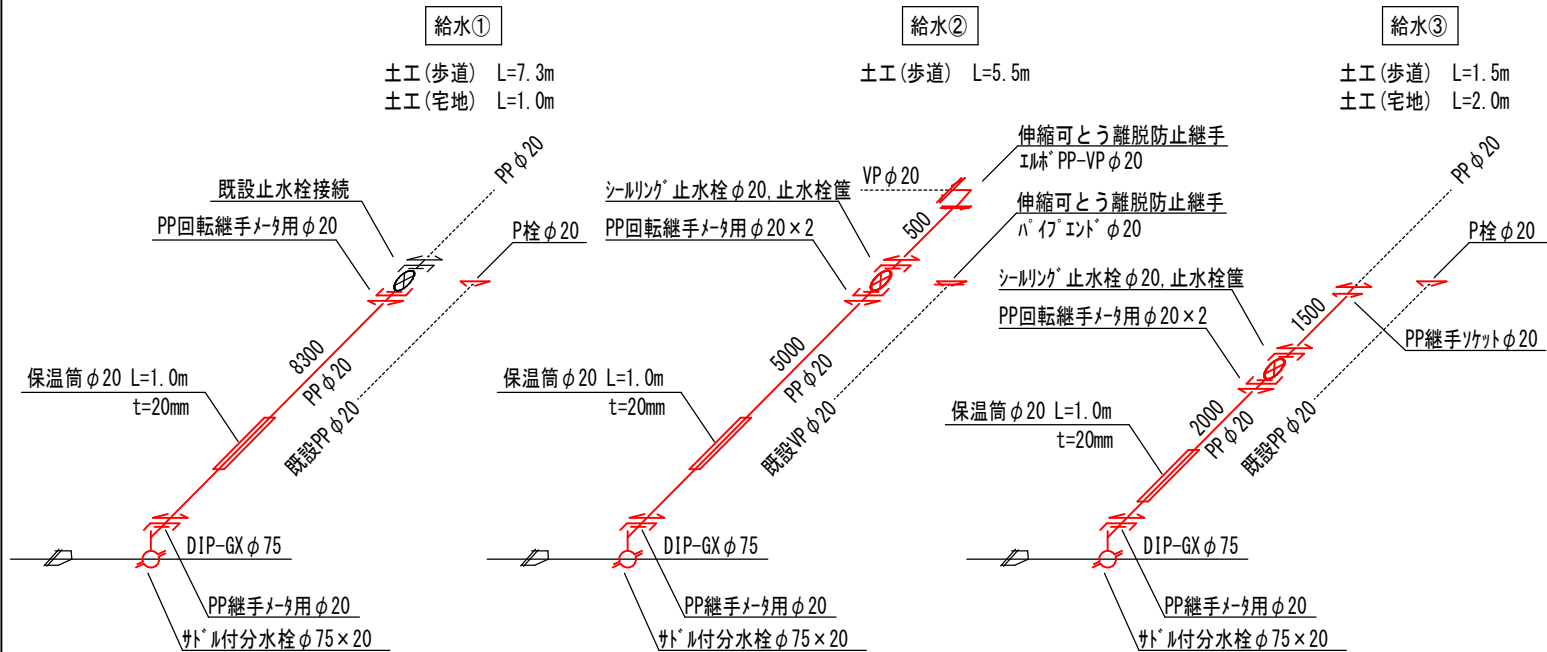

- 【凡例】
- : 既設管 (Existing pipe)
 - : 新設管 (本工事) (New pipe (this work))
 - : 新設管 (別工事) (New pipe (other work))

R8実施

宮古市上下水道部施設課	工 事 名	一般国道45号神林地区 配水管布設工事		
	図 種	給水切替詳細図		
	縮 尺	図 示		
	年 月	令和 8年10月	業 内	10 / 10